


Watch

Displaying and changes of object values

Selecting the item **Watch** from the menu **Objects** opens the following dialog box to display and change values of objects.

Value of the particular objects in process **D2000 CNF** can be displayed and changed in dialog box that displays after double click on the object and selection the item **References** from pop-up menu (by right-clicking in [configuration dialog box](#)).

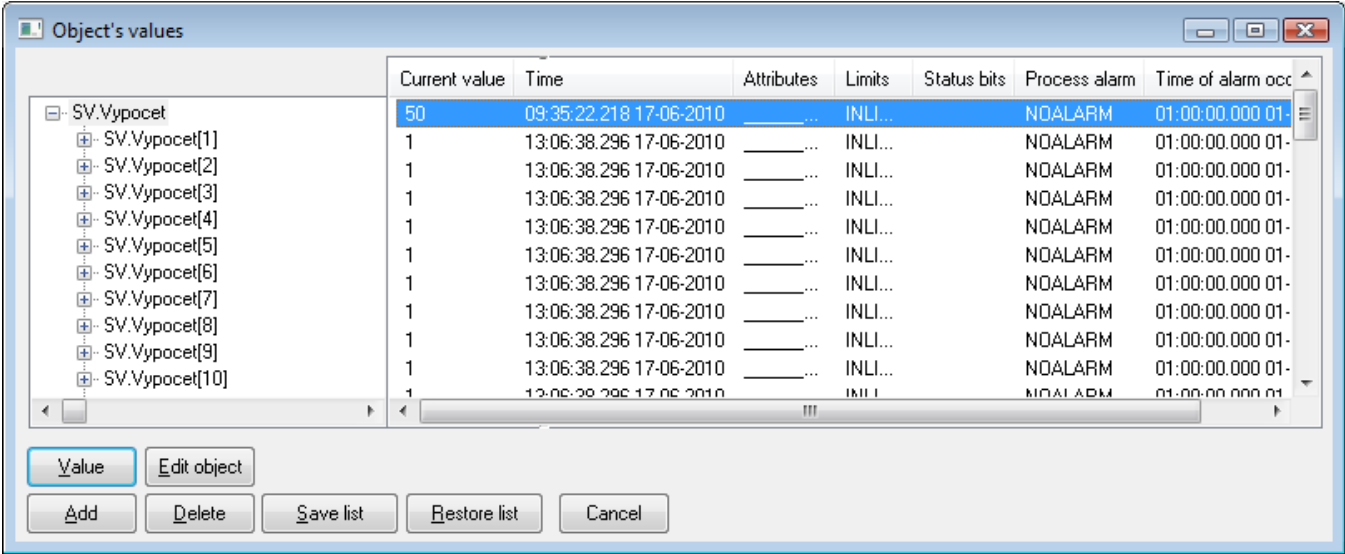

Meaning of individual buttons in the dialog box is described in the following table.

Button	Meaning
Add	Adds an object(s) to the list in the dialog box - it opens the list of D2000 system objects.
Delete	Deletes the selected object(s) from the list.
Value	Opens the dialog box that displays all attributes of selected object value.
Edit object	Opens the configuration dialog box of selected object.
Save List	Saves the current list of objects.
Restore List	Opens the saved list of objects.
Close	Closes the "Watch " dialog box.
Row	Sets the particular row near the references on structure column.

Left part of the dialog window displays a value identifier and right one a value in the form of table. If the display value is structured, its structure is showed in the left part.

Display value can be:

- object from system
- row of structure - row is inserted behind the structured variable name on the elementary level. In some situations, it is possible to write the reference on column of structure within object configuration (row index is [0]).
- item of structure
- item of historical value array

If, at least one row of structure is showed, the option of numeric value Row is accessible in dialog box. This option determines the particular row of structured variable from which the values are monitored. In the left part of dialog box, only used items are displayed at structured values (if it is possible). Click on button **Value** opens the dialog window that shows all attributes of specific value:

SV.Vypocet[6]^Op1

Value Status

- ☒ Valid
- ☐ Process Alarm
- ☐ Unacknowledged Alarm
- ☐ Block Alarm
- ☐ Weak
- ☐ Unacknowledged Value
- ☐ Transient
- ☐ Default Value
- ☒ Manual
- ☐ Critical Alarm
- ☒ Unknown Value

About Value

Type: Integer

Value Time: 17-06-2010 13:06:28.000

Limits: INLIMIT

Process Alarm

Type: NOALARM

User Flags

☐ A ☐ B ☐ C ☐ D ☐ E ☐ F ☐ G ☐ H
☐ I ☐ J ☐ K ☐ L ☐ M ☐ N ☐ O ☐ P

Alarm: Null time

☒ Reference to Object ☒ Log Changes

Sec

Value

28

Set Cancel

The part **Value** is variable. It depends on the value type, that is currently displayed. If an item of structure of *Object* type is displayed (reference to object), the checkbox **Reference to object** is checked. The input field placed above the checkbox contains the name of associated object.

Note:

The dialog box also allows you to view the values of [ESL local variables](#).