


Changing the object parent

!!! WARNING: Process D2000 SysEdit is not supported from Version 7.2 and later !!!

Each object of D2000 system has its parent within the frame of the object architecture. Parent object is defined during the object configuration in processes [D2000 CNF](#) or [D2000 SysEdit](#). The off-line configuration process - **D2000 SysEdit** allows to change parent for selected objects. Process **D2000 CNF** do not allow this intervention into the system.

Clicking the item **Parent Change** from the menu **Objects** opens the following dialog box.

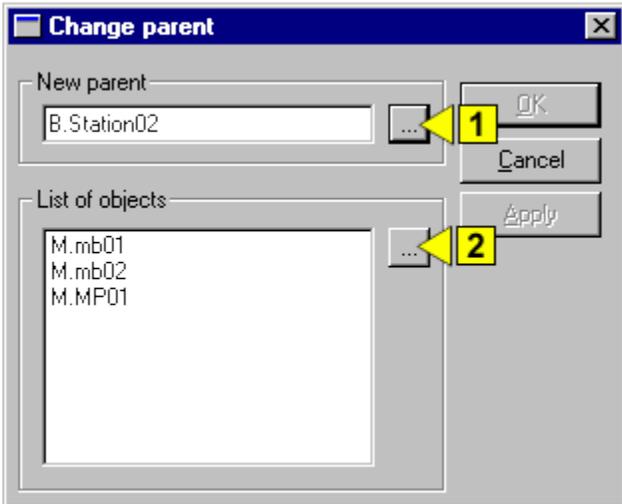

1	Select a new parent for selected objects.
2	Select object, for which you want to change the parent object.

New parent

Name of new parent object for all the selected object listed in **List of objects**. Clicking the button placed right from this input field (1) opens the list of D2000 system objects which allows to select a parent.

List of objects

List of objects, for which you assign a new parent object in the input field **New parent**. Parent can be changed only for object of some types. The overview of these types shows the following table.

Object type	Parent object type
Eval tag	Process D2000 Calc (*.CLC)
Event	Process D2000 Event Handler (*.EVH)
Historical value	Process D2000 Archiv (*.ARC)
I/O tag	Object of Station type
Line	Process D2000 KOM (*.KOM)
Logical group	Object of Logical group type or the object <i>LOGGROU</i> P (of System type)
Remote tag	Process D2000 GateWay Client (*.GTW)
Station	Object of Line type
User variable	The object <i>USER_VAR</i> (of System type) or a process D2000 Event Handler (*.EVH)

Change of object parent for selected objects is executed by clicking the **Apply** button.