


Configuration of Parameters for the Archive

At its start, the archive reads the necessary parameters from the system registry. Their values are set in the [D2000 Management Console](#). Access to the configuration is via the menu **Configuration -> SELF.ARC**.



A list of parameters for the archive is displayed in the window. Parameters can be created, deleted or their values edited.

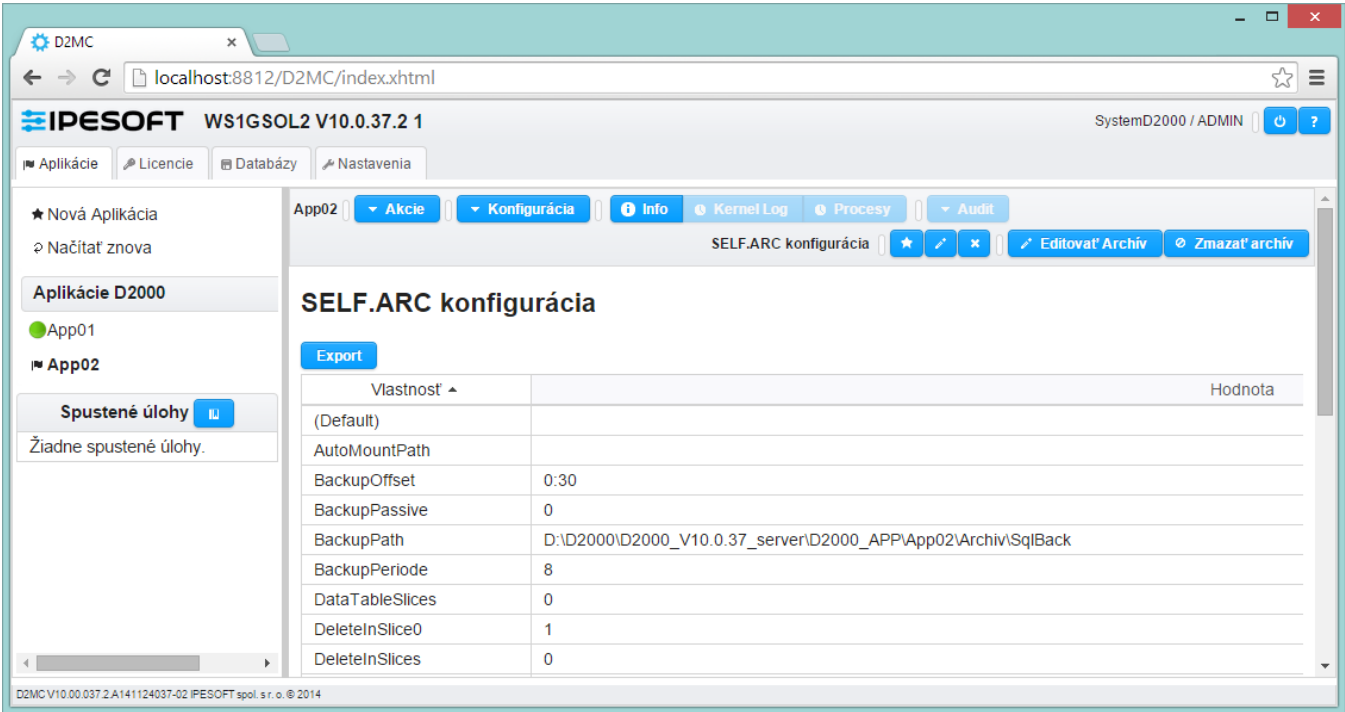

Adding a Parameter

A new parameter can be added after click the  button **Create**. The dialog box for defining the parameter opens.

Create static property

Kľúč

Typ

STRING

Hodnota


Vytvoriť

Zrušiť

Parameter	Meaning
-----------	---------

Key (Klíč)	Name of the parameter
Type (Typ)	Type of parameter - STRING or INTEGER.
Value (Hodnota)	Field for entering a value.

Editing Values of a Parameter

The value of any parameter can be changed by clicking on the button  **Edit**. The dialog box for editing the parameter opens.

✕

Edit static property

Klíč

BackupOffset

Typ

STRING

Hodnota

Editovat

Zrušit